



TYPE 2	
TYPE 2A	SAME AS TYPE 2 EXCEPT CARRY GYPSUM WALLBOARD TO FLOOR/ ROOF DECK ABOVE
TYPE 2B	SAME AS TYPE 2 EXCEPT 6" METAL STUDS @ 16" O.C.

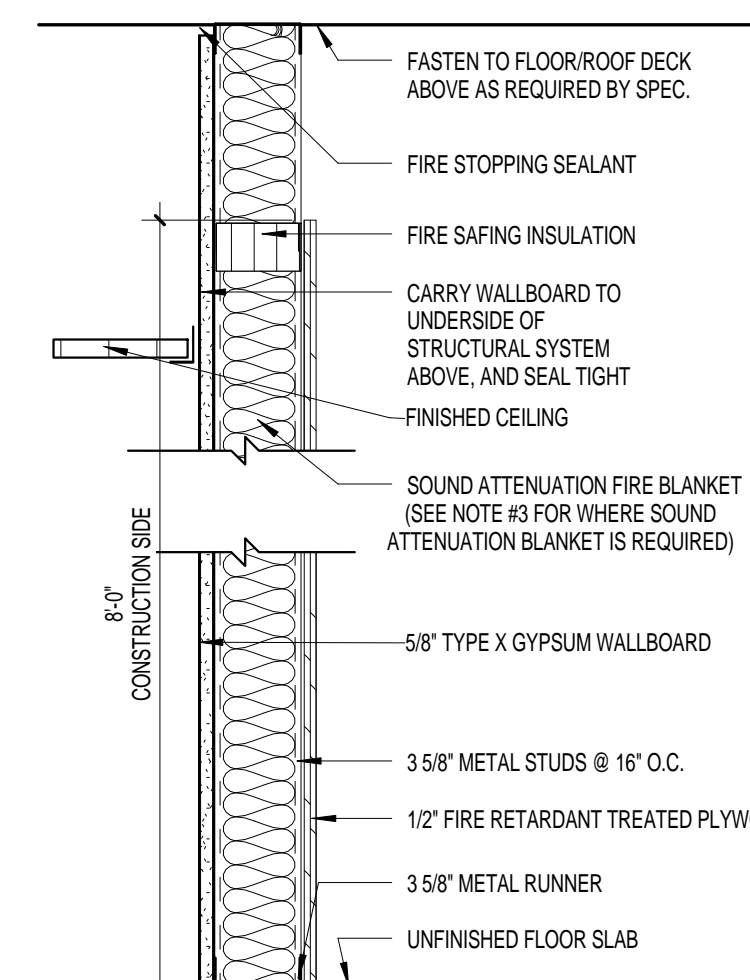


TYPE T TEMPORARY PARTITION

CONSTRUCT PARTITION TO BE SOLID AND SEALED AT ENTIRE PERIMETER TO PREVENT THE TRANSMISSION OF DUST

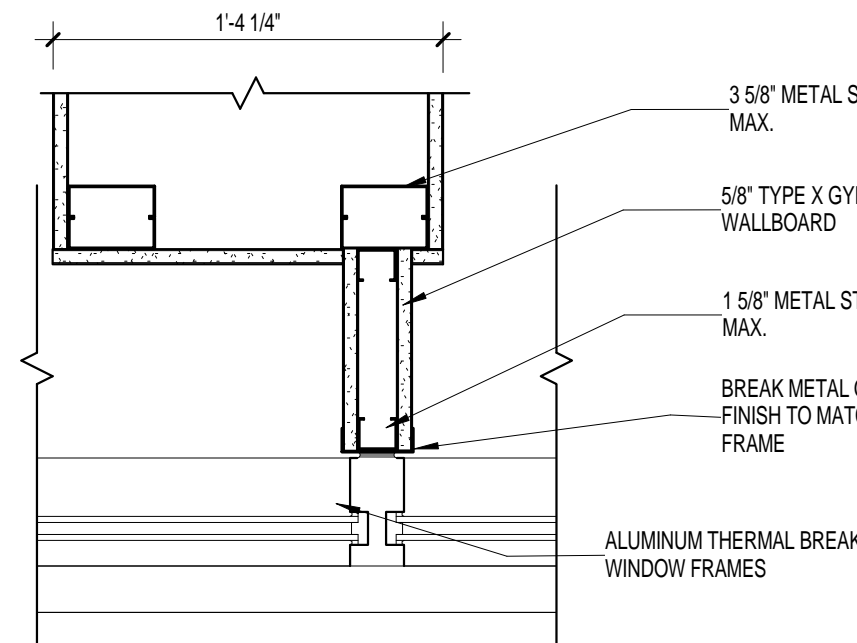


E8 DETAIL @ WINDOW INTERSECTION AND PLUMBING CHASE
1 1/2" = 1'-0"

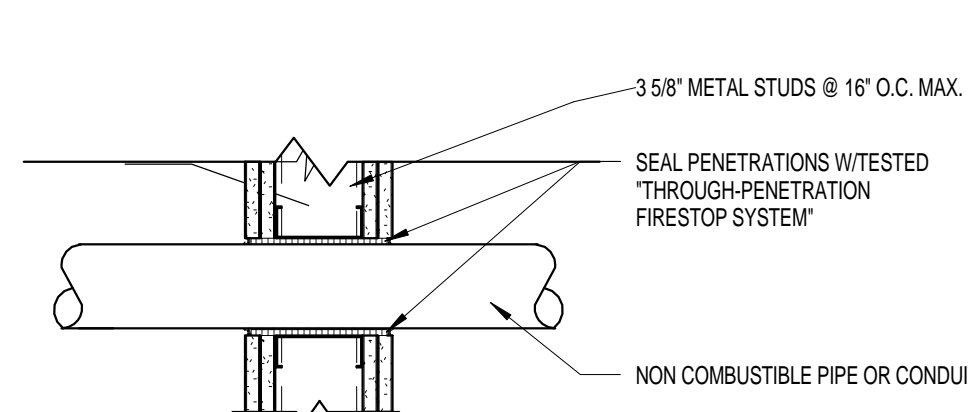


NOTES:

1. IF ANY PIPES ARE TO BE INSULATED, DO NOT RUN INSULATION THROUGH A RATED _____ AND/OR RATED SMOKE WALL. AFTER SEALING PENETRATIONS AROUND PIPE THROUGH WALL WITH _____ THROUGH PENETRATION FIRESTOP SYSTEM, FLARE INSULATION ONTO FACE OF WALL AROUND PIPE ON BOTH SIDES OF WALL, AND SEAL TO FACE OF WALL WITH INSULATION MASTIC.
2. COMBUSTIBLE CONDUIT AND/OR PIPE IS NOT ALLOWED
3. THIS IS A TYPICAL ARRANGEMENT. REPEAT THIS PROCEDURE AS NEEDED TO ACCOMMODATE ALL NONCOMBUSTIBLE CONDUIT AND PIPE PENETRATIONS THROUGH THE WALLS.

(F7) PARTITION HEAD DETAILS 2
1 1/2" = 1'-0"

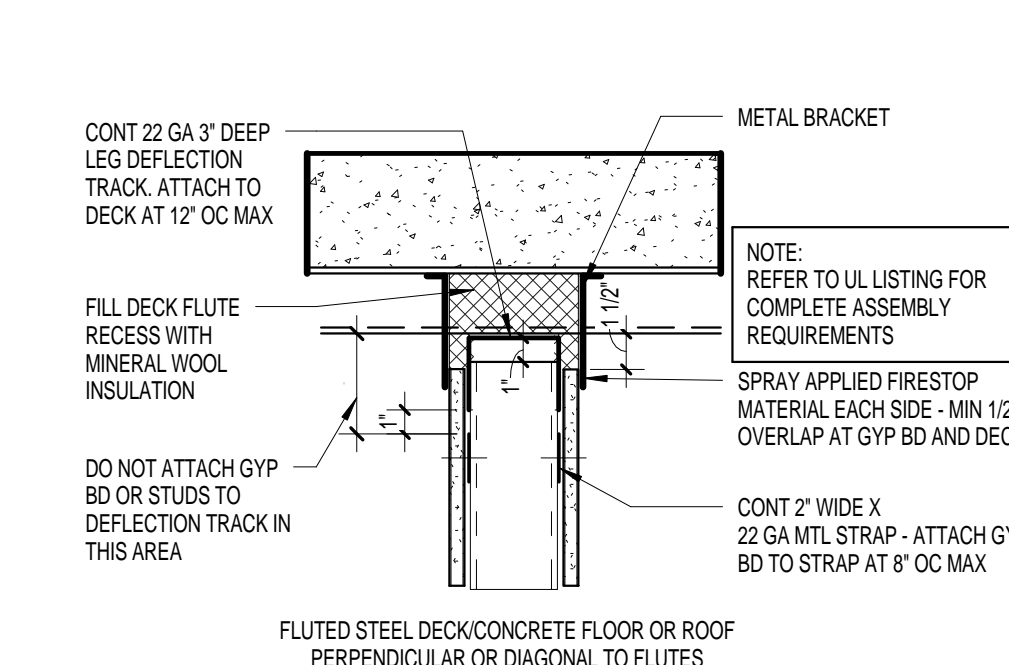

ONE HOUR FIRE RATED AND ONE HOUR
FIRE RATED SMOKE BARRIER UL-HW-D
0107

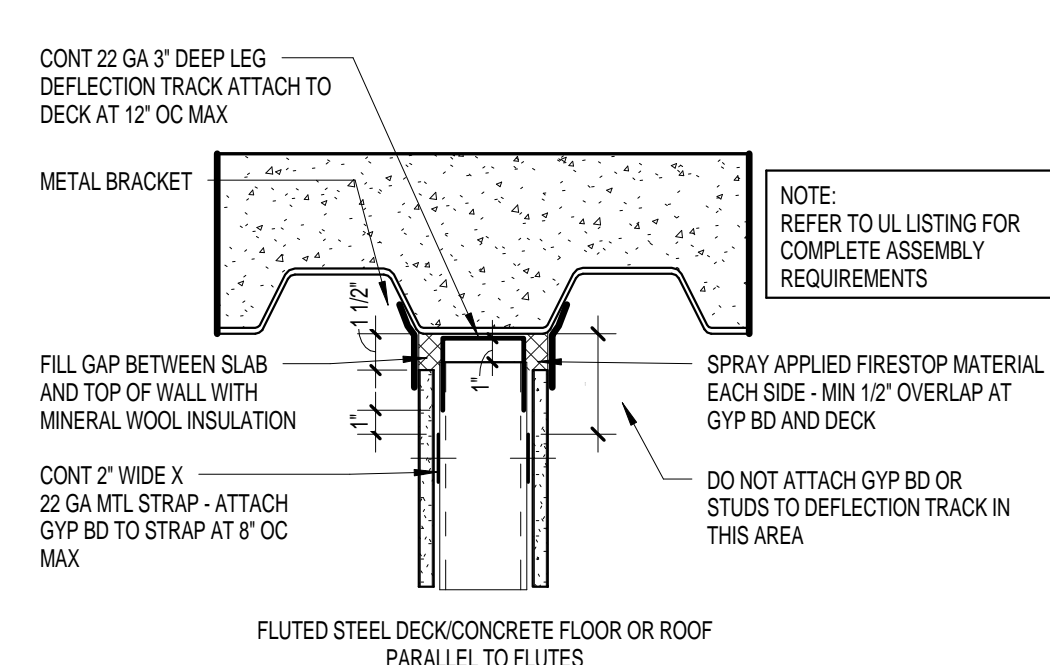

(F8) PARTITION HEAD DETAILS
1 1/2" = 1'-0"

F2 TYPICAL MULTIPLE NONCOMBUSTIBLE CONDUIT OR PIPE PENETRATION THROUGH RATED FIRE WALLS AND/OR RATED SMOKE WALLS
1 1/2" = 1'-0"

Associate Architects
W. COOK
ARCHITECTS

PARTITION TYPES



Approved: Project Director

AE621

Office of
Facilities
Management

 Department of
Veterans Affairs

NOTE: SEE SHEET AE-002 FOR ALTERNATES

FULLY SPRINKLERED
ISSUED FOR BID